
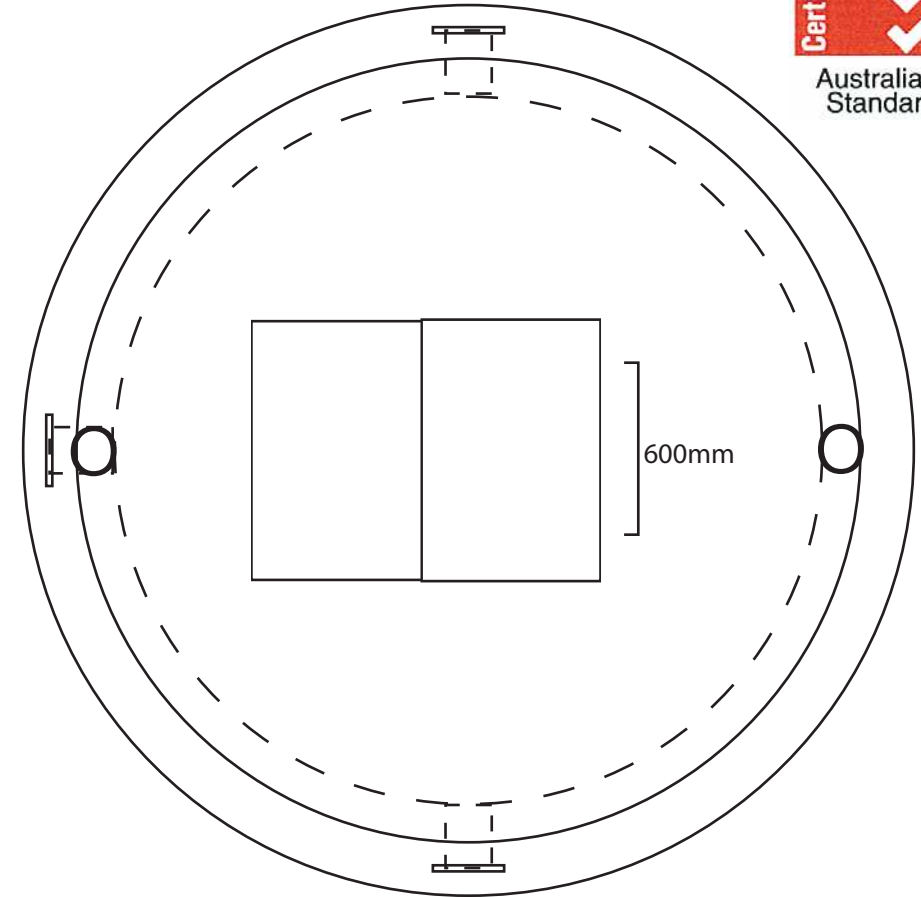


4000L SEPTIC

AS/NZS 1546.1:2008
Licence No: 1486

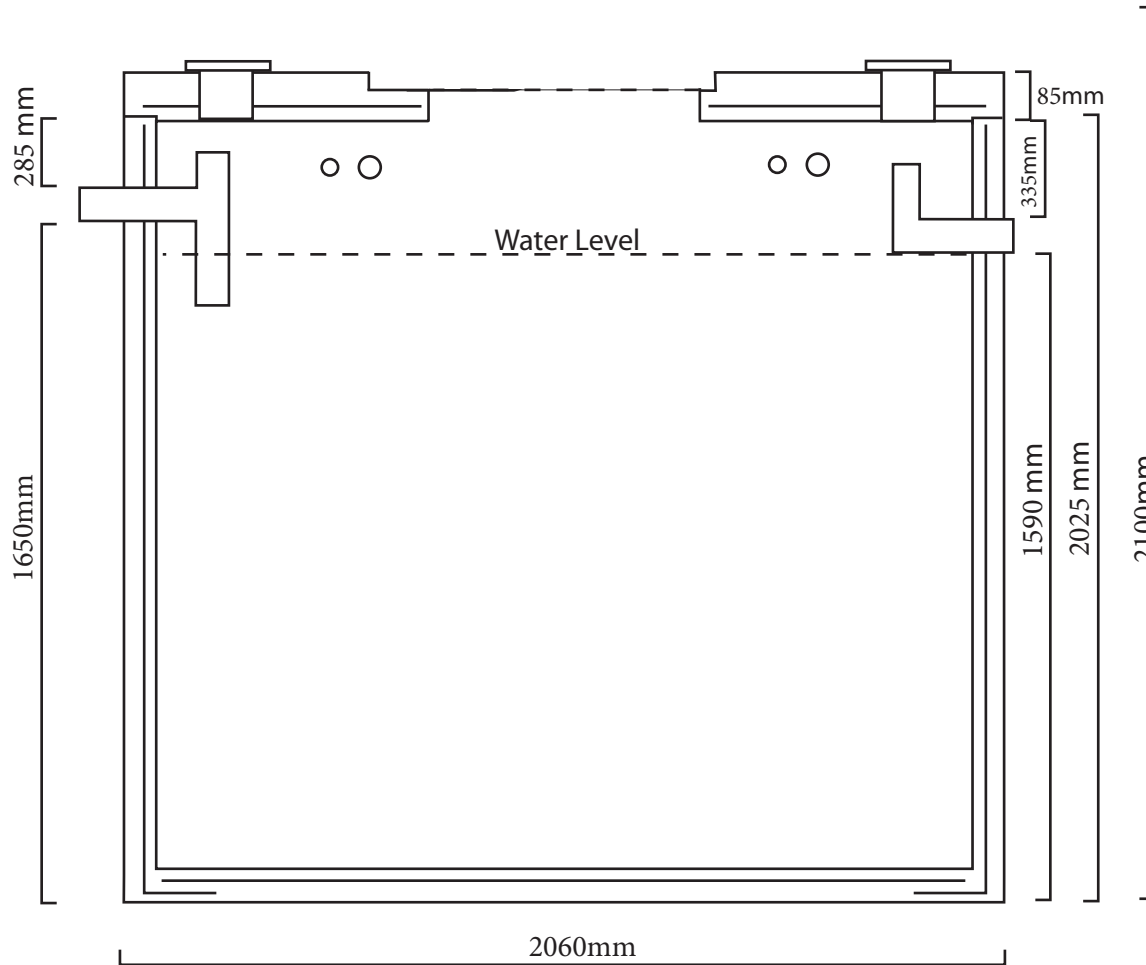

Installation instructions: Hole excavation must be 2.2m square with depth of 1815mm. Base must be covered with 50mm of sand or equivalent.